

Other Requirements

- The sewer pipe shall be
PVC--SDR--26 or
DUCTILE IRON CL 52
 - There shall be four inches (4") of
stone bedding under the pipe
 - The pipe shall be covered with
stone backfill a minimum of twelve
inches (12") over the top of the pipe
 - The approved stone shall be
CA--6 GRADE 8 or 9 or
CA--11 #6 WASHED
-
- There shall be no boring or tunneling
under the public sidewalk. If you need to
repair or replace a section under a public
sidewalk, the walk must be removed and
replaced using three (3) pieces of re-bar
across the trench.
 - A contractor must have a floating bond
with the Village, or the contractor or
homeowner shall place a \$200 cash
refundable bond which will be refunded
when the job is completed and restoration
has occurred.




Permit Submission Requirements

In addition to a completed application, all
permit submissions are required to include
the following information:

- Complete the diagram on the reverse
side of this handout.


*In most cases, your sewer repair permit
will be issued over the counter. If for
some reason this cannot be
accomplished, you will be given an
approximate date when your permit will
be issued.*



Questions ?

*Please call
the Department of
Engineering & Community
Development
at
(847) 357-4220
Monday through Friday,
between the hours of
8:00 a.m. and 5:00 p.m.*

Sewer Repair

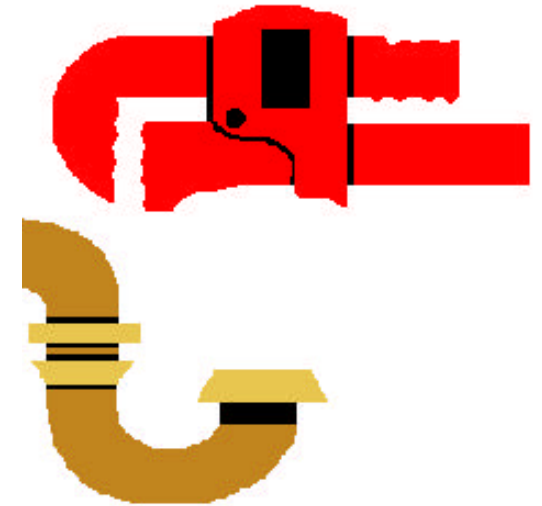

*A How-to Guide for Obtaining a Permit
for your Project*



Elk Grove Village
Home Improvement
Series



RESIDENTIAL SEWER SERVICE REPAIR DIAGRAM

• ESTIMATED PIPE LENGTH _____

• INSTALL CLEANOUT

YES _____

NO _____

• SEWER PIPE


PVC--SDR--26

DUCTILE IRON CL 52

• STONE

CA--6 GRADE 8 or 9

CA--11 #6 WASHED

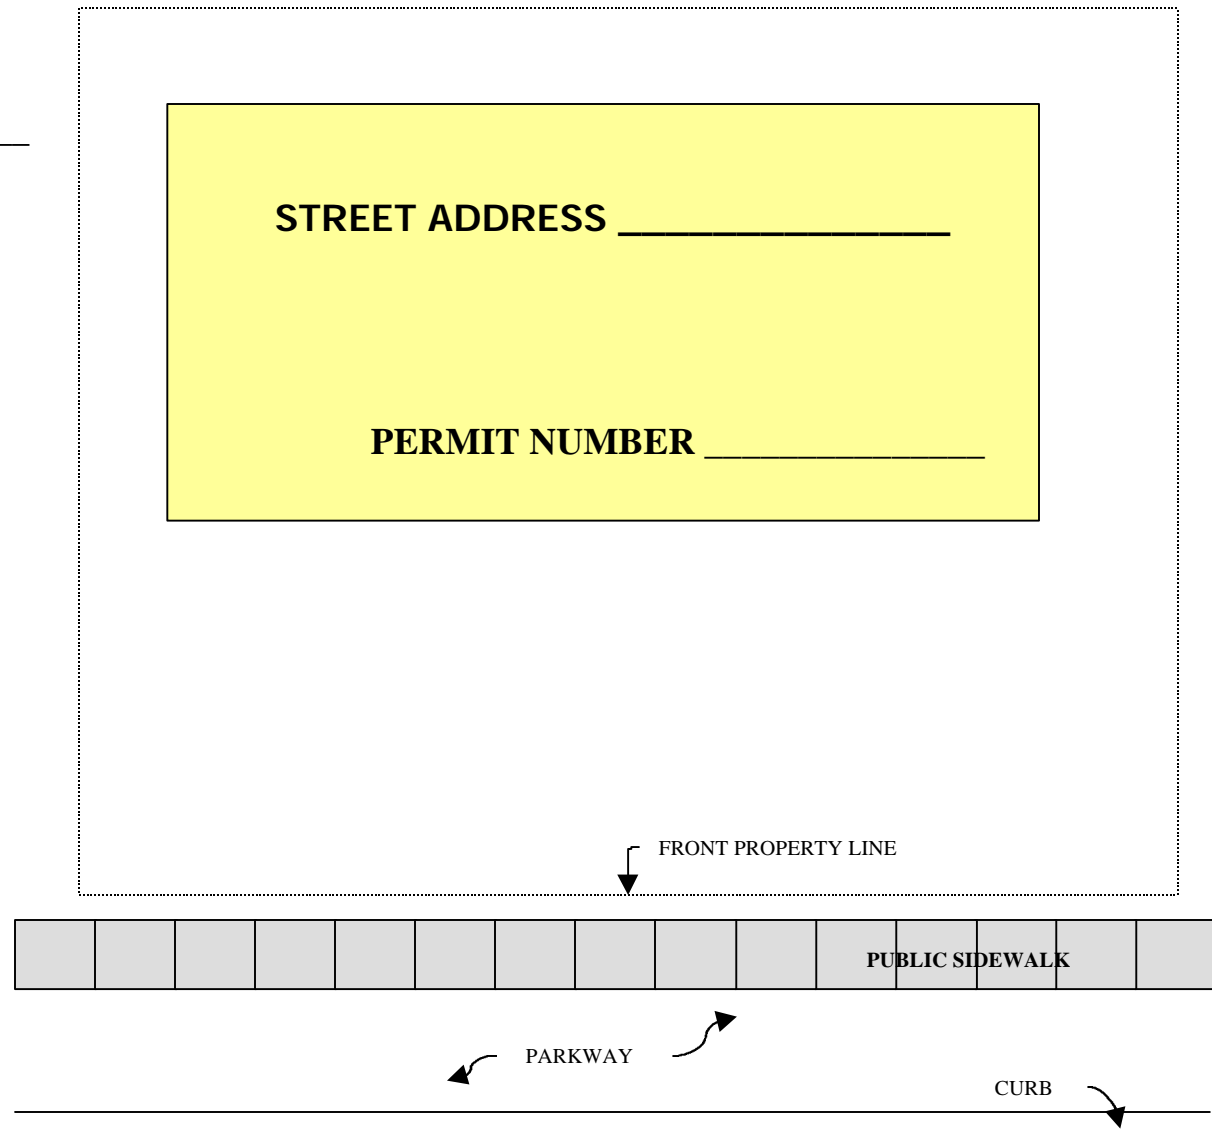

**FOR UTILITY LOCATIONS
PLEASE CALL**

J.U.L.I.E. AT 1-800-892-0123 and
ELK GROVE PUBLIC WORKS AT (847)734-8800
AT LEAST 48 HOURS IN ADVANCE